


# WIRING SCHEMATIC

## Delta Dual V4/6 + Delta UPS V4/6

### Delta UPS V4/6 (DMS E022)

### Distribution board, 240 V AC

### Delta HLA (DMS 190)

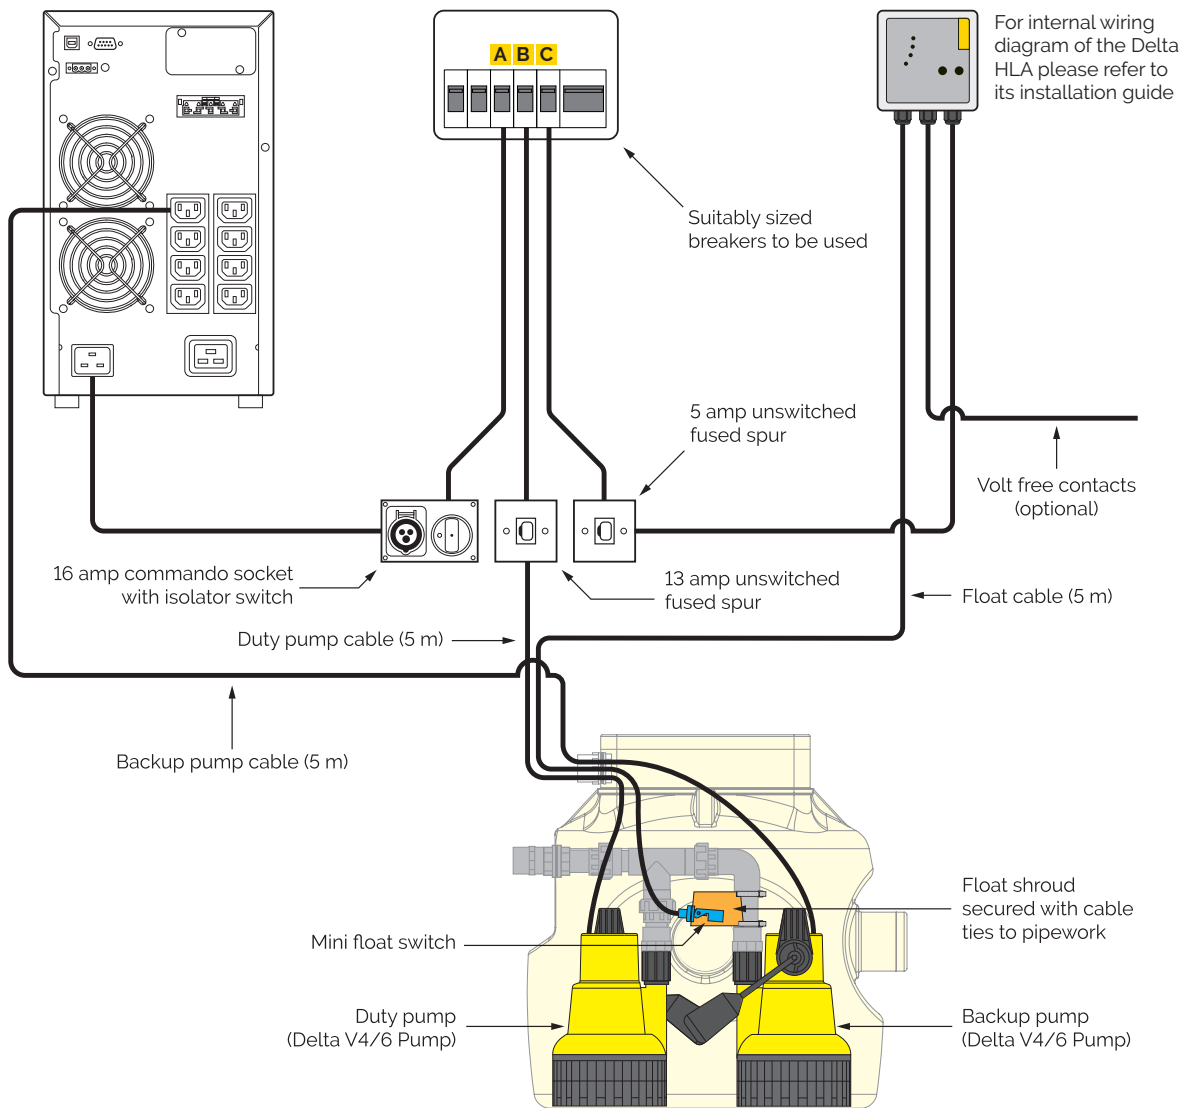

### Delta Dual V4/6 packaged pumping station (DMS 217/079)

#### BREAKER SPECIFICATION

Description	Device type	Rating
A Delta UPS V4/6	RCBO, Type C	20 A
B Delta V4/6 Pump	RCBO, Type C	10 A
C Delta HLA	MCB	6 A

#### HEALTH AND SAFETY REQUIREMENTS

Only qualified personnel should carry out the electrical installation in accordance with BS 7671 "Requirements for Electrical Installations. IET Wiring Regulations", and the Health and Safety at Work Act 1974.

#### CABLE EXTENSIONS

If cable extensions are required for the pump power cable or the float cable, a qualified electrical contractor must make all electrical connections. Suitable cable extension kits are available to order from Delta Membranes on 01992 523 523 between 8am and 5pm, Monday to Friday or by email at [info@deltamembranes.com](mailto:info@deltamembranes.com)